MARIA^{TM} Service Options

DUSTREAM^{TM}

Collect Sample:

- Dust Sample (Use *DUSTREAM^{TM}*)
- Air Filter Sample
- Other Biologic Sample
- Environmental Sample

Inspect each sample

A minimum of 30mg of dust required.

No → Repeat Sampling

Yes

Submit Sample to:
Indoor Biotechnologies, Inc.
Indoor® Allergen Analysis Service
Request: MARIA^{TM} Service Options
1216 Harris Street
Charlottesville, VA 22903

MARIA^{TM} Service Options:
8-Plex Array: Der p 1, Der f 1, Der p 2, Fel d 1, Can f 1, Bla g 2, Rat n 1, Mus m 1

Performed by INDOOR:
- Sample acceptance.
- Sample Extraction and Preparation
- Perform MARIA^{TM} 8-Plex Array
- Report analysis Results to Clients*

* Turn around time: 5 Days

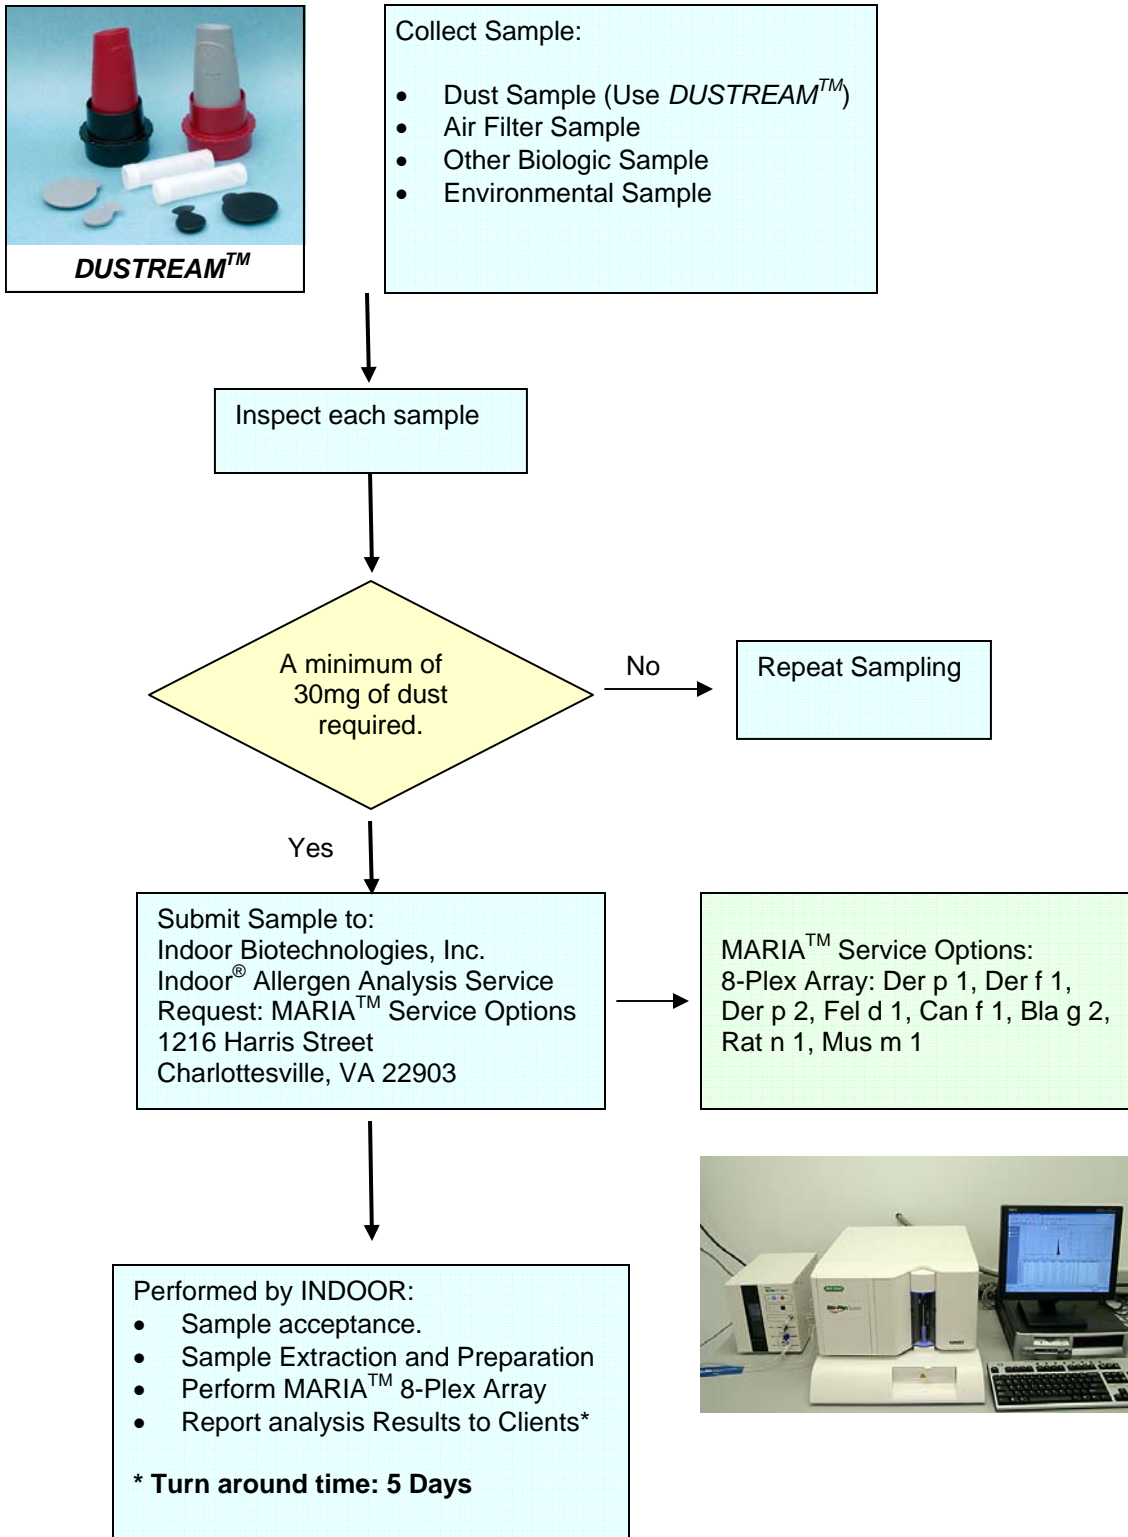# DUSTREAM^{TM} + MARIA^{TM} Service Options = IAQ Allergen Exposure Assessment